

OPERATING MANUAL



Introduction

Quick open and close, less flowing resistance. PTFE sealing, perfect sealing, high temperature, corrosion resistance, acid and alkali resistance. The main features of the valve itself is compact, easy operation and maintenance for water, acids and natural gas general working media.

Pneumatic Actuator


| | |
|--------------------|---|
| Double acting | Air to open, air to close, air supply failure to keep the current position |
| Single Acting N/C | Air to open, interrupt air to close, air failure to close |
| Single Acting N/O | Air to close, interrupt air to open, air failure to open |
| Optional accessory | Reversing solenoid valve, limit switch box, air filter reducing valve, positioner, handle manual, lock up valve |



Technical Parameters

| Valve Body | | Valve Components | |
|--------------------|----------------------|------------------|--|
| Size Range | DN15~DN200 | Body Material | Stainless Steel, WCB |
| Operating Pressure | 1.6MPa ~6.4MPa | Core Material | Stainless Steel, WCB |
| End Connection | Flange | Sealing Material | PTFE: -30°C~180°C PPL: -30°C~250°C |
| Structure | 3 way L-Port/ T-Port | Applicable Media | Control of Water, Air, Gas, Oil, Liquid, Steam |


T-Pattern Flow Direction Diagram

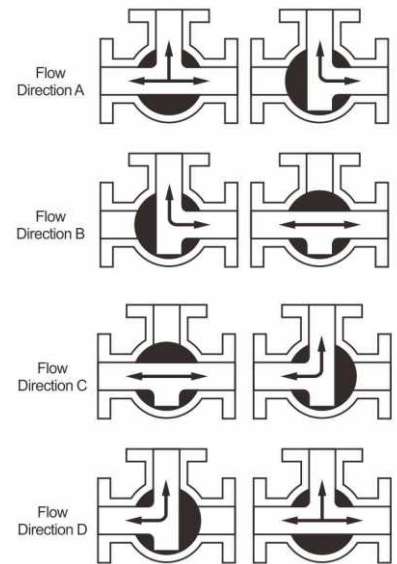

Qutine Size drawing


| MEDLE | DN15 | DN20 | DN25 | DN32 | DN40 | DN50 | DN65 | DN80 | DN100 | DN125 | DN150 | DN200 |
|----------|-------|-------|-------|--------|--------|-------|--------|-------|-------|-------|-------|-------|
| G | 1/2" | 3/4" | 1" | 1-1/4" | 1-1/2" | 2" | 2-1/2" | 3" | 4" | 5" | 6" | 8" |
| D3 | 15 | 20 | 25 | 30 | 40 | 50 | 65 | 80 | 100 | 125 | 150 | 200 |
| D2 | 45 | 55 | 65 | 78 | 85 | 100 | 120 | 135 | 155 | 185 | 210 | 265 |
| D1 | 65 | 75 | 85 | 100 | 110 | 125 | 145 | 160 | 180 | 210 | 240 | 295 |
| D | 95 | 105 | 115 | 135 | 145 | 160 | 180 | 195 | 215 | 245 | 280 | 335 |
| L | 150 | 164 | 180 | 200 | 220 | 240 | 260 | 280 | 320 | 380 | 440 | 550 |
| H | 53 | 58.5 | 70 | 77.5 | 88.5 | 92 | 107 | 119 | 150 | 200 | 240 | 300 |
| B | 72 | 80 | 90 | 100 | 110 | 120 | 130 | 140 | 160 | 190 | 220 | 260 |
| n-φd | 4-φ14 | 4-φ14 | 4-φ14 | 4-φ18 | 4-φ18 | 4-φ18 | 4-φ18 | 8-φ18 | 8-φ18 | 8-φ18 | 8-φ28 | 4-φ23 |
| Actuator | AT63 | AT63 | AT63 | AT75 | AT83 | AT92 | AT105 | AT125 | AT140 | AT160 | | |


L-Pattern Flow Direction Diagram

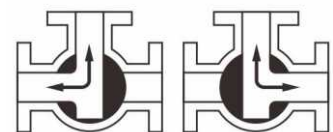

Maintenance

- Tightening the seal between the valve and the actuator:
Remove the four bolts underneath the actuator.
Separate the actuator from the valve.
Tighten the nut on the top of the valve body.
Place the actuator back on the valve and screw everything back into place.
- Tightening the seals between the valve and the inlet/outlet ports:
Remove the torque bolts and check for any debris or damage to the gaskets.
Use a torque wrench or other consistent method of tightening the torque bolts to reconnect the inlet and outlet ports.

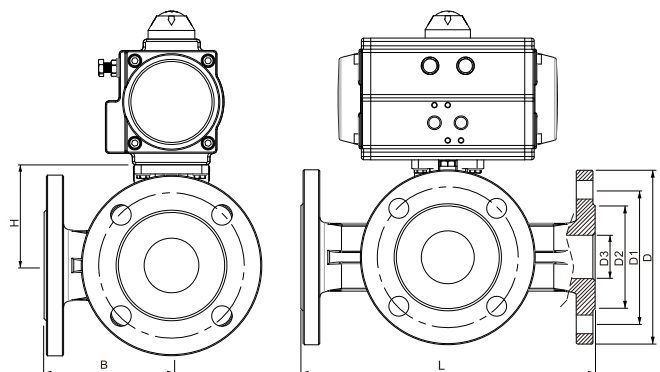

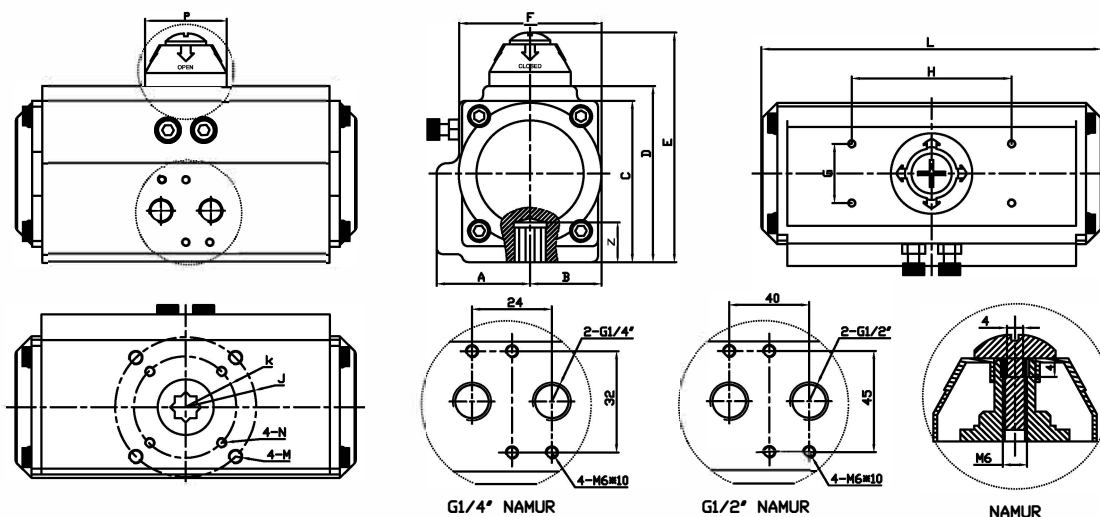

Introduction

1. Operating media: Dry or lubricated air, or the non-corrosive gases The maximum particle diameter must less than 30 u m
2. Air supply pressure: The minimum supply pressure is 2.5 Bar The maximum supply pressure is 8 Bar
3. Operating temperature: Standard: -20° c~+ 80° c Low temperature: -35° c ~ +80° c High temperature: -15° c ~ M50° c
4. Travel adjustment: Have adjustment range of ± 5° for the rotation at 0° and 90°

Outline Size drawing

| MODEL | A | B | C | D | E | F | G | H | J | K | N | M | L | P | Z | Air Hole |
|-------|------|------|-------|-------|-------|-------|----|-----|------|------|--------|--------|-----|----|----|-------------|
| AT52 | 30 | 42.5 | 65.5 | 72.4 | 92.5 | 50.5 | 30 | 80 | ∅36 | ∅50 | M5×8 | M6×10 | 150 | 42 | 14 | NAMUR G1/4" |
| AT63 | 36 | 47 | 81 | 88.5 | 98.5 | 69.5 | 30 | 80 | ∅50 | ∅70 | M6×10 | M8×13 | 171 | 42 | 18 | NAMUR G1/4" |
| AT75 | 42.5 | 53 | 93 | 100 | 120 | 78 | 30 | 80 | ∅50 | ∅70 | M6×10 | M8×13 | 186 | 42 | 18 | NAMUR G1/4" |
| AT83 | 46.5 | 57 | 98.5 | 109.7 | 129.5 | 86 | 30 | 80 | ∅50 | ∅70 | M6×10 | M8×13 | 206 | 42 | 21 | NAMUR G1/4" |
| AT92 | 50 | 58 | 106 | 117 | 137 | 90 | 30 | 80 | ∅50 | ∅70 | M6×10 | M8×13 | 265 | 42 | 21 | NAMUR G1/4" |
| AT105 | 57.5 | 64 | 122.5 | 135 | 155 | 104.5 | 30 | 80 | ∅70 | ∅102 | M8×13 | M10×16 | 272 | 42 | 27 | NAMUR G1/4" |
| AT125 | 67.5 | 74.5 | 145.5 | 157 | 177 | 120.5 | 30 | 80 | ∅70 | ∅102 | M8×13 | M10×16 | 304 | 60 | 27 | NAMUR G1/4" |
| AT140 | 75.5 | 75.5 | 161 | 174 | 194 | 125 | 30 | 80 | ∅102 | ∅125 | M10×16 | M12×20 | 395 | 60 | 32 | NAMUR G1/4" |
| AT160 | 87 | 87 | 184 | 198 | 228 | 143 | 30 | 80 | ∅102 | ∅125 | M10×16 | M12×20 | 462 | 60 | 32 | NAMUR G1/4" |
| AT190 | 103 | 103 | 216 | 232 | 262 | 172 | 30 | 130 | ∅102 | ∅140 | M10×16 | M16×25 | 520 | 85 | 40 | NAMUR G1/4" |
| AT210 | 113 | 113 | 235.5 | 257 | 287 | 194 | 30 | 130 | ∅102 | ∅140 | M10×16 | M16×25 | 538 | 85 | 40 | NAMUR G1/4" |
| AT240 | 130 | 130 | 235.5 | 292 | 322 | 230 | 30 | 130 | | ∅165 | | M20×30 | 592 | 90 | 50 | NAMUR G1/4" |
| AT270 | 147 | 147 | 235.5 | 331 | 361 | 253 | 30 | 130 | | ∅165 | | M20×30 | 713 | 90 | 50 | NAMUR G1/2" |
| AT300 | 161 | 168 | 235.5 | 354 | 384 | 290 | 30 | 130 | ∅165 | ∅215 | M20×30 | M20×30 | 771 | 90 | 50 | NAMUR G1/2" |

Common faults and inspection, troubleshooting

| Failure Phenomenon | Inspection Items | Solution |
|------------------------------|--|--|
| Pneumatic Valve Can Not Move | The electromagnetic valve is normal, Coil is burned, electromagnetic valve is stuck being stolen | Solenoid valve replacement, Replacement coils, remove stolen Property. |
| | A separate air supply pneumatic Actuator test check seals and Whether the cylinder is damaged. | Replace a bad ring and cylinder. |
| | There are impurities in the spool Valve stuck. | Remove impurities, replace Damaged parts. |
| | the handle in a manual hand motor location. | Interchange |
| Slow Motion, Crawling | Supply pressure is not enough. | The increase of gas supply pressure(0.4-0.7mpa) |
| | Pneumatic actuator outputtorque is Too small. | Increase the pneumatic actuator Production. |
| | The valve spool or valve assembly too tight. | Re-assembly adjustments. |
| | Air supply pipe plug, flow is too small. | Exclude plug, replace the filter cartridge. |
| Reply Devices Without Signal | power line short circuit or open circuit. | Maintenance of power lines. |
| | reply within the cam position is not accurate. | Adjust the cam to the correct location |
| | Micro switch damaged. | Replacement micro switch |